


117MM Ø DUCT IN FOOTWAY

(SUITABLE FOR THREE-PHASE SERVICE)

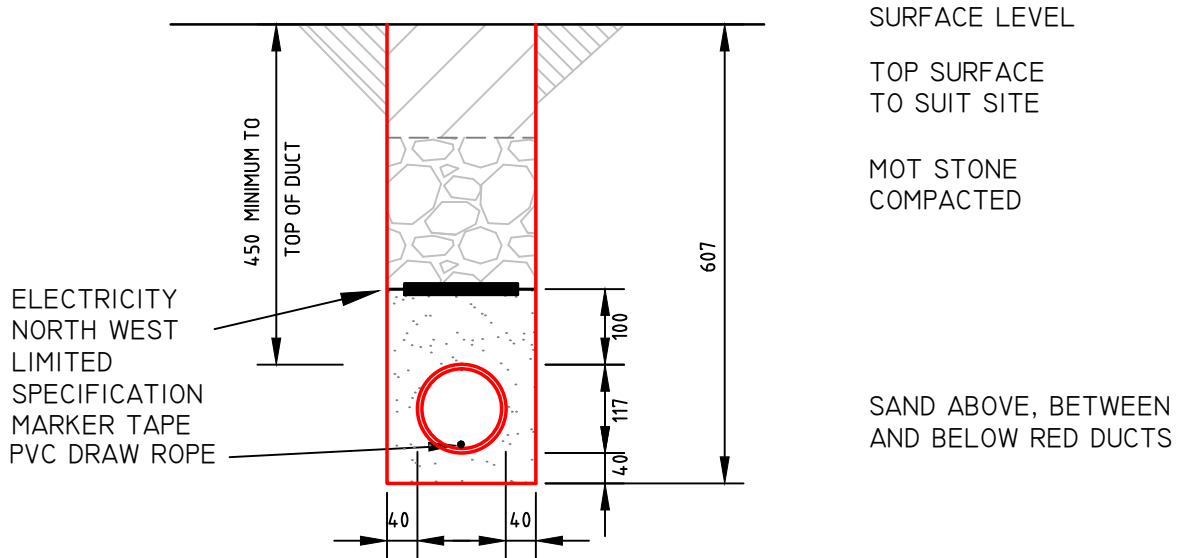

- 1, DUCTING TO COMPLY WITH ELECTRICITY NORTH WEST LIMITED SPECIFICATION ES400D4.
 - 2, DUCTING TO BE 117MM Ø RED PVC AND DISPLAY THE WORDS "ELECTRIC CABLE DUCT"
 - 3, DUCTING TO BE INSTALLED AT NO COST TO ELECTRICITY NORTH WEST LIMITED.
 - 4, DRAW ROPE TO BE PROVIDED AND INSTALLED BY DEVELOPER.
- DUCTS AND MARKER TAPE TO BE INSTALLED IN ACCORDANCE WITH ELECTRICITY NORTH WEST LIMITED SPECIFICATION ES400E4
- ELECTRICITY NORTH WEST LIMITED RED DUCTING MUST NOT BE USED FOR ANY OTHER PURPOSE THAN ELECTRICITY NORTH WEST LIMITED CABLE INSTALLATION ON THE SITE.
- DUCTS TO BE INSPECTED BY ELECTRICITY NORTH WEST LIMITED REPRESENTATIVE BEFORE BACKFILLING.

CABLE-DUCT TRENCH SPECIFICATION FOR INSTALLATION BY DEVELOPER FOR USE BY ELECTRICITY NORTH WEST LIMITED.

117MM Ø DUCT IN FOOTWAY

DRG No: ENWL-108 SCALE 1:10

electricity
northwest

Bringing energy to your door