


38MM Ø DUCT IN CARRIAGEWAY

(SUITABLE FOR SINGLE-PHASE SERVICE)

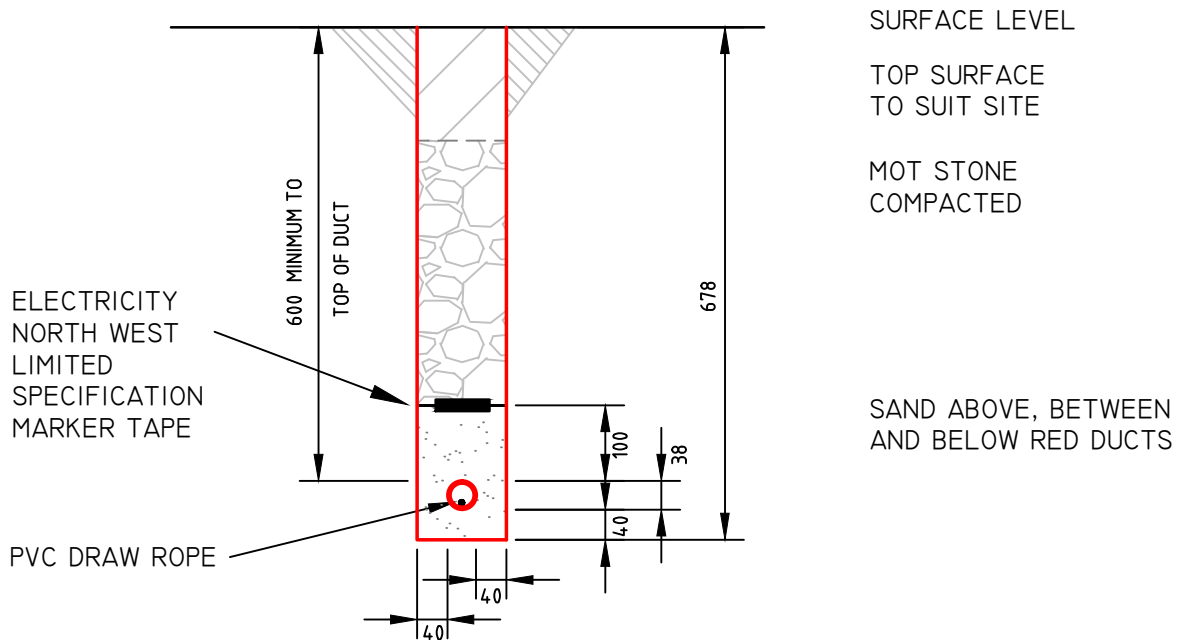

- 1, DUCTING TO COMPLY WITH ELECTRICITY NORTH WEST LIMITED SPECIFICATION ES400D4.
- 2, DUCTING TO BE 38MM Ø RED PVC AND DISPLAY THE WORDS "ELECTRIC CABLE DUCT"
- 3, DUCTING TO BE INSTALLED AT NO COST TO ELECTRICITY NORTH WEST LIMITED.
- 4, DRAW ROPE TO BE PROVIDED AND INSTALLED BY DEVELOPER.

DUCTS AND MARKER TAPE TO BE INSTALLED IN ACCORDANCE WITH ELECTRICITY NORTH WEST LIMITED SPECIFICATION ES400E4

ELECTRICITY NORTH WEST LIMITED RED DUCTING MUST NOT BE USED FOR ANY OTHER PURPOSE THAN ELECTRICITY NORTH WEST LIMITED CABLE INSTALLATION ON THE SITE.

DUCTS TO BE INSPECTED BY ELECTRICITY NORTH WEST LIMITED REPRESENTATIVE BEFORE BACKFILLING.

CABLE-DUCT TRENCH SPECIFICATION FOR INSTALLATION BY DEVELOPER FOR USE BY ELECTRICITY NORTH WEST LIMITED.

38MM Ø DUCT IN CARRIAGEWAY

DRG No: ENWL-III

SCALE 1:10

electricity
northwest

Bringing energy to your door