


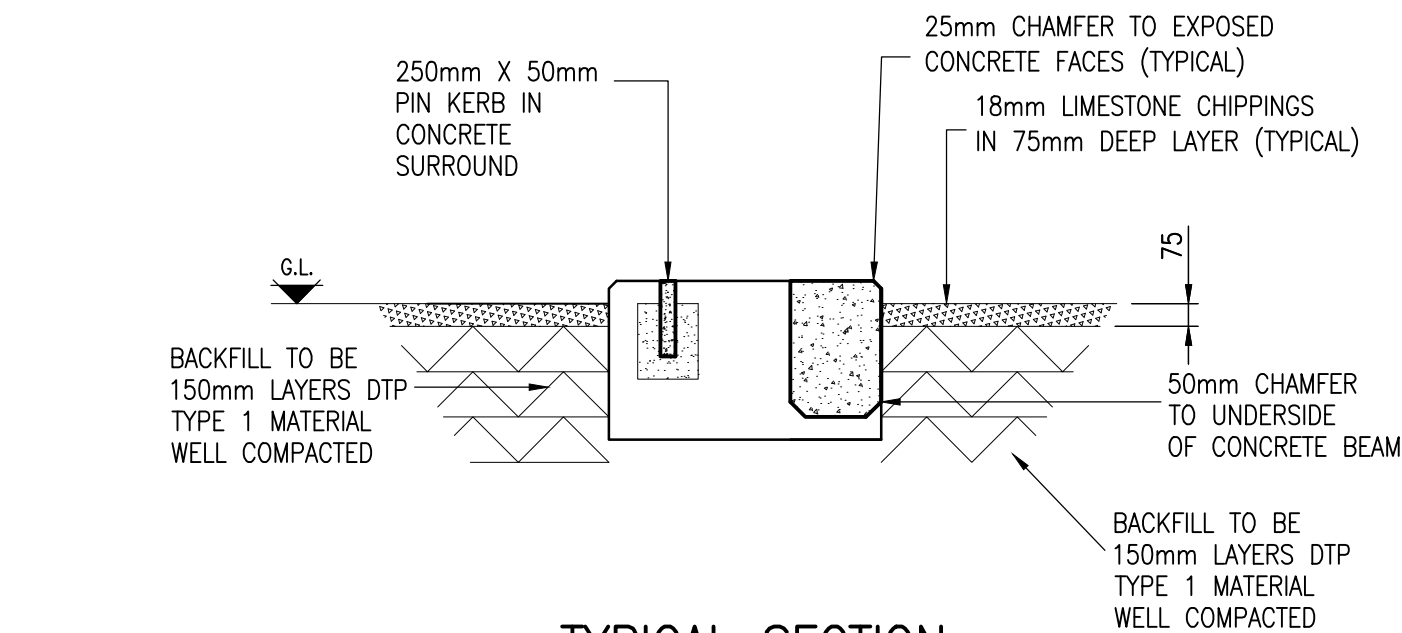

TYPICAL SECTION

NOTE
THE EARTHING TAPE IS ATTACHED TO THE MAIN REINFORCEMENT AND ROUTED TO EMERGE FROM THE INTERNAL FACE OF THE FORMWORK FOR THE FUTURE CONNECTION TO THE SWITCH HOUSE EARTHING SYSTEM.

T10 OR T12 REINFORCING BAR, FIXED WITHIN STRUCTURE, TIED TO A 150mm LONG T16 REINFORCING BAR AND TOGETHER CLAMPED WITHIN UBOLT.

CLAMPED CONNECTION WRAPPED WITH DUCK TAPE PRIOR TO POURING CONCRETE


'U' BOLT CLAMP, 25mm ROD DIA. TWIN PLATE, 25x3, BY OMEGA (TEL. No 0115 8767689) TO ACCOMMODATE A 25x4mm EARTH TAPE.

DETAIL OF REINFORCEMENT/EARTHING CLAMP


(SCALE 1:5)

SITE NOTES


1. CONTRACTOR TO OBTAIN UNDERGROUND CABLE & SERVICE RECORDS PRIOR TO COMMENCEMENT OF ANY WORKS.
2. THE CONTRACTOR MUST ASSUME THAT ANY EXISTING CABLES LOCATED WITHIN THE WORKS ARE LIVE AND LIAISE WITH THE ELECTRICITY NORTH WEST ENGINEER FOR ADVICE.
3. SITE SPECIFIC RISK ASSESSMENT TO BE UNDERTAKEN PRIOR TO COMMENCEMENT OF ANY WORKS.
4. FOUNDATION DESIGN HAS BEEN BASED ON A SUITABLE BEARING PRESSURE FOR MOST GROUND CONDITIONS INCLUDING CLAYS. FORMATION LEVEL FOR FOUNDATIONS TO BE TAKEN DOWN TO GROUND THAT IS SUFFICIENTLY FIRM TO PROVIDE PHYSICAL SUPPORT TO THE STRUCTURE.
5. FOUNDATION FORMATION LEVELS TO BE INSPECTED AND APPROVED PRIOR TO FOUNDATION CONSTRUCTION.
6. B.S. PIN KERB 250mm x 50mm WITH CONCRETE SURROUND TO BE PLACED AT FRONT EDGE OF THE CABINET.

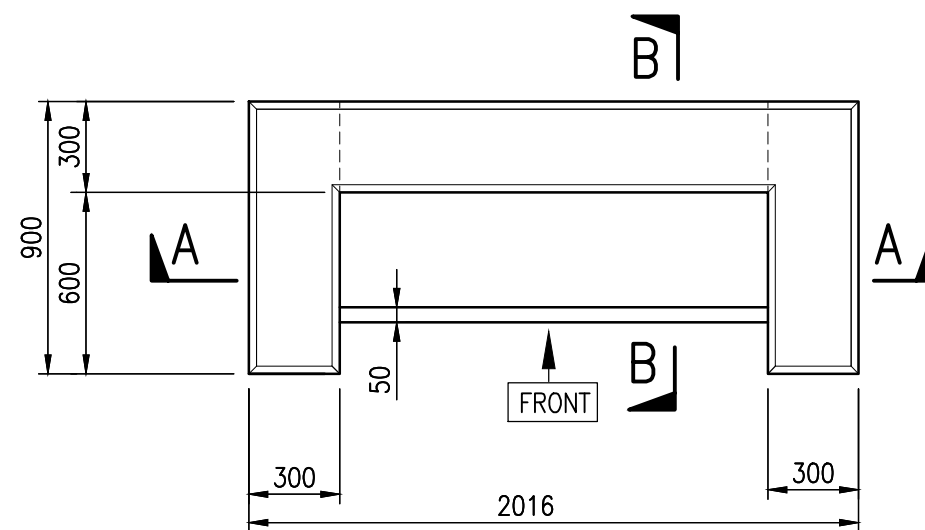

PLAN

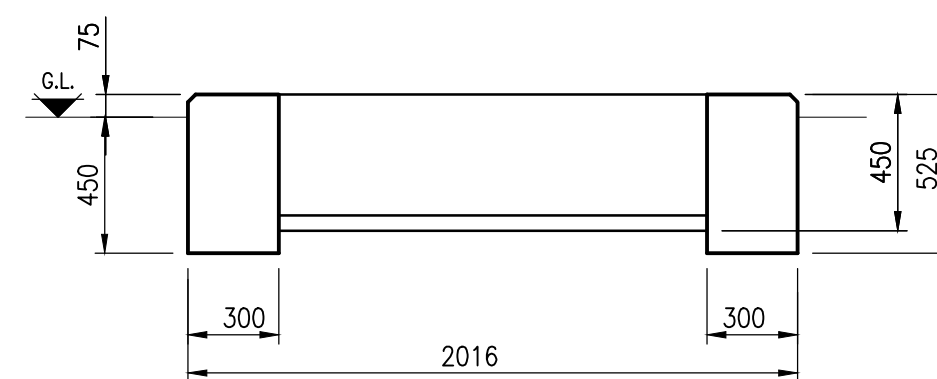

SECTION A-A

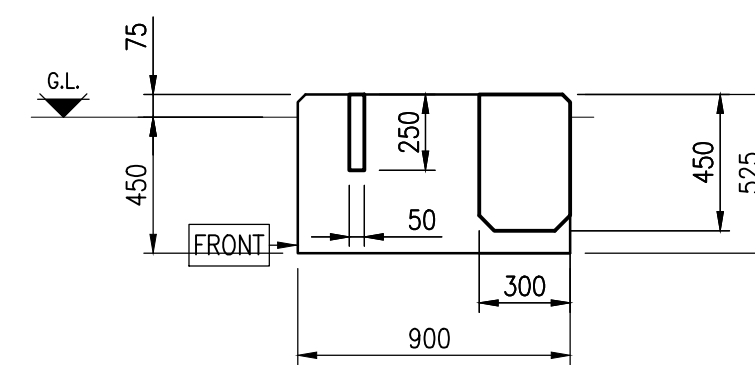


SECTION B-B

GENERAL NOTES


1. DO NOT SCALE.
2. ALL DIMENSIONS ARE IN MILLIMETRES UNLESS NOTED OTHERWISE.
3. THIS DRAWING IS TO BE READ IN CONJUNCTION WITH ELECTRICITY NORTH WEST CODE OF PRACTICE ES352
4. ALL WORK TO CARRIED OUT IN ACCORDANCE WITH CURRENT BUILDING REGULATIONS AND RELEVANT BRITISH STANDARDS AND CODES OF PRACTICE.

CONCRETE GENERAL ARRANGEMENT

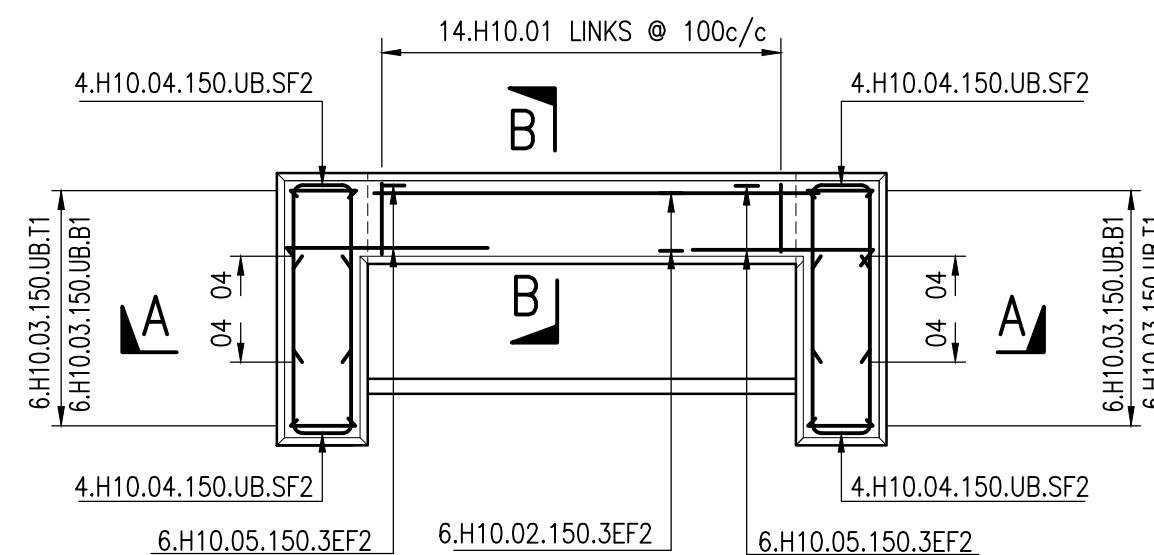


PLAN

REINFORCEMENT DETAILS

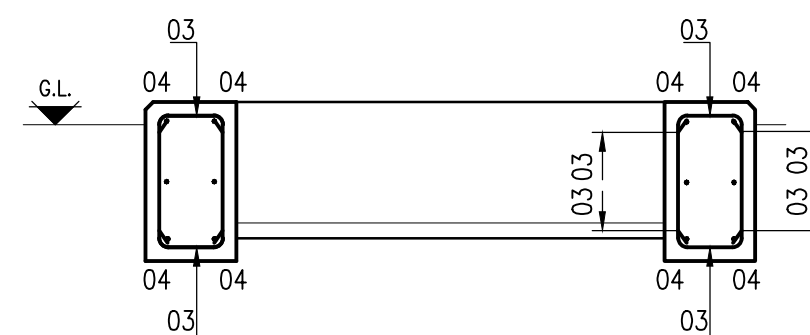


SECTION A-A

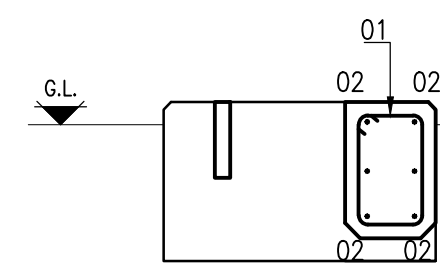


SECTION B-B

REINFORCEMENT NOTES

1. Concrete to be strength class C32/40 to BS 8500.
2. Loose bar reinforcement to have the following minimum laps UNO: -
- H10 = 350mm
- H12 = 420mm
3. Standard A393 fabric mesh to have a minimum lap of 270mm.
4. 40mm cover to all reinforcement UNO.
5. Bar references shall be interpreted thus: -

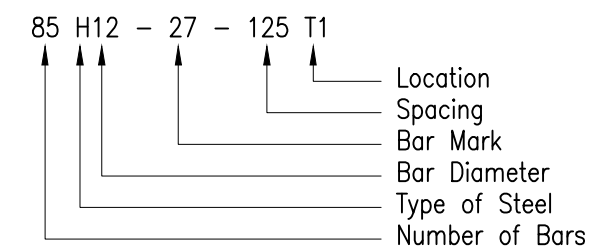

6. Locations: -
- T1 Denotes Top face, top layer
- T2 Denotes Top face, second layer
- B2 Denotes Bottom face, second layer
- B1 Denotes Bottom face, bottom layer
7. "H" Denotes deformed Type 2 high yield steel bars to BS 4449:2005 - characteristic yield strength 500MPa.

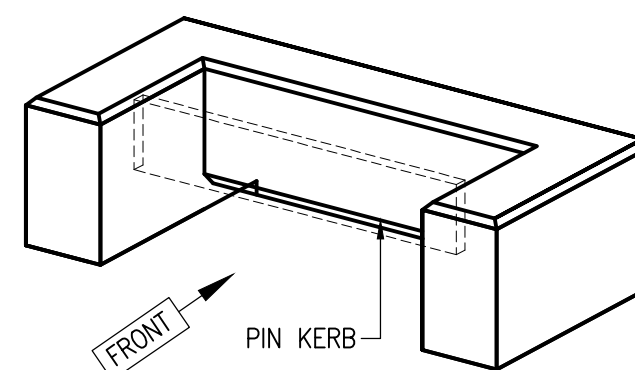

ISOMETRIC VIEW

BENDING SCHEDULE TO BS 8666:2005									
Bar mark	Type & size	No. of mbrs	No. of bars in each	Total no.	Length of each bar † mm	Shape code	A * mm	B * mm	C * mm
01	H10	1	14	14	1325	51	215	365	
02	H10	1	6	6	1375	00	1375		
03	H10	1	24	24	975	21	395	215	(395)
04	H10	1	16	16	1325	21	580	190	(580)
05	H10	1	12	12	800	11	170	650	

† Specified in multiples Of 25mm

* Specified in multiples Of 5mm

				CIVIL DISTRIBUTION SUBSTATION			
FREDERICK ROAD, SALFORD M6 6QH TEL 0161 6041370				PLINTH FOR SCHNEIDER SHIELDED FEEDER PILLAR 7 WAY 1600A			
DRAWN	GK	SCALE	1:25	SITE NAME	-	DWG STATUS	APPROVAL
APPROVED	WD	DATE	SEPT 2013	P.F.R. NO.	-	DWG NO	900350-010
OLD DWG NO	-	SHEET SIZE	A2	DWG NO	900350-010	REV	1