



PLAN VIEW

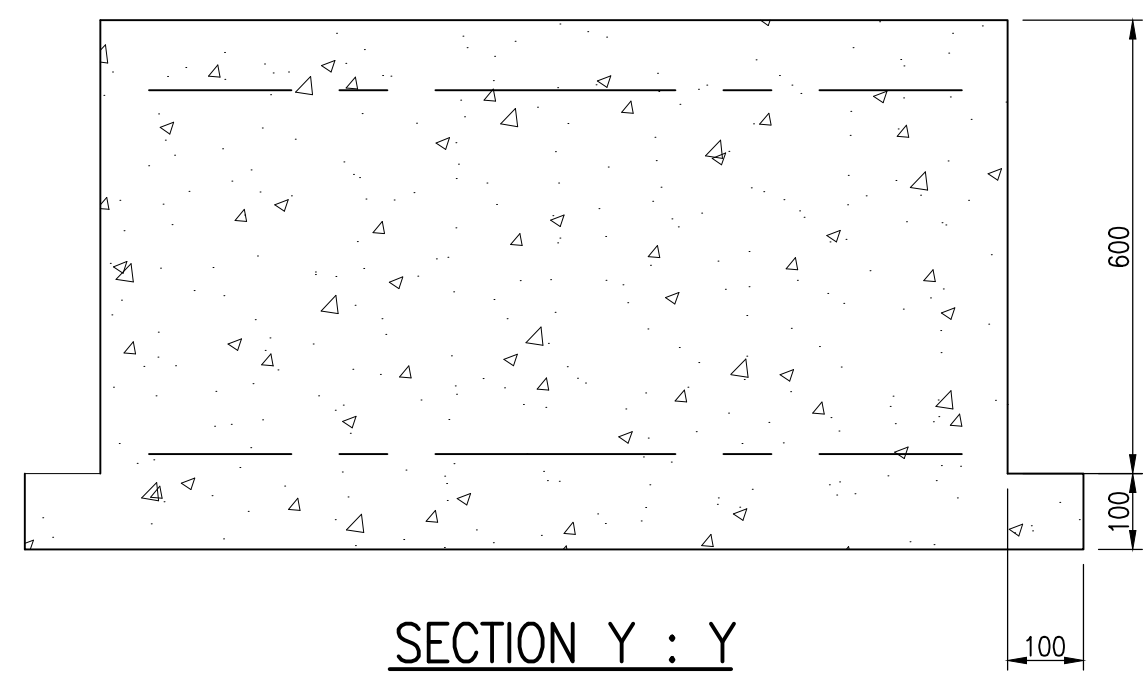


SECTION Y : Y

SWITCHGEAR PLINTH TO 700 THICK
CONCRETE WITH A252 REINFORCEMENT
TOP & BOTTOM WITH 50 MM COVER TO
SIDES AND TOP ARRISSES TO BE REMOVED
FROM TOP EDGES OF PLINTH

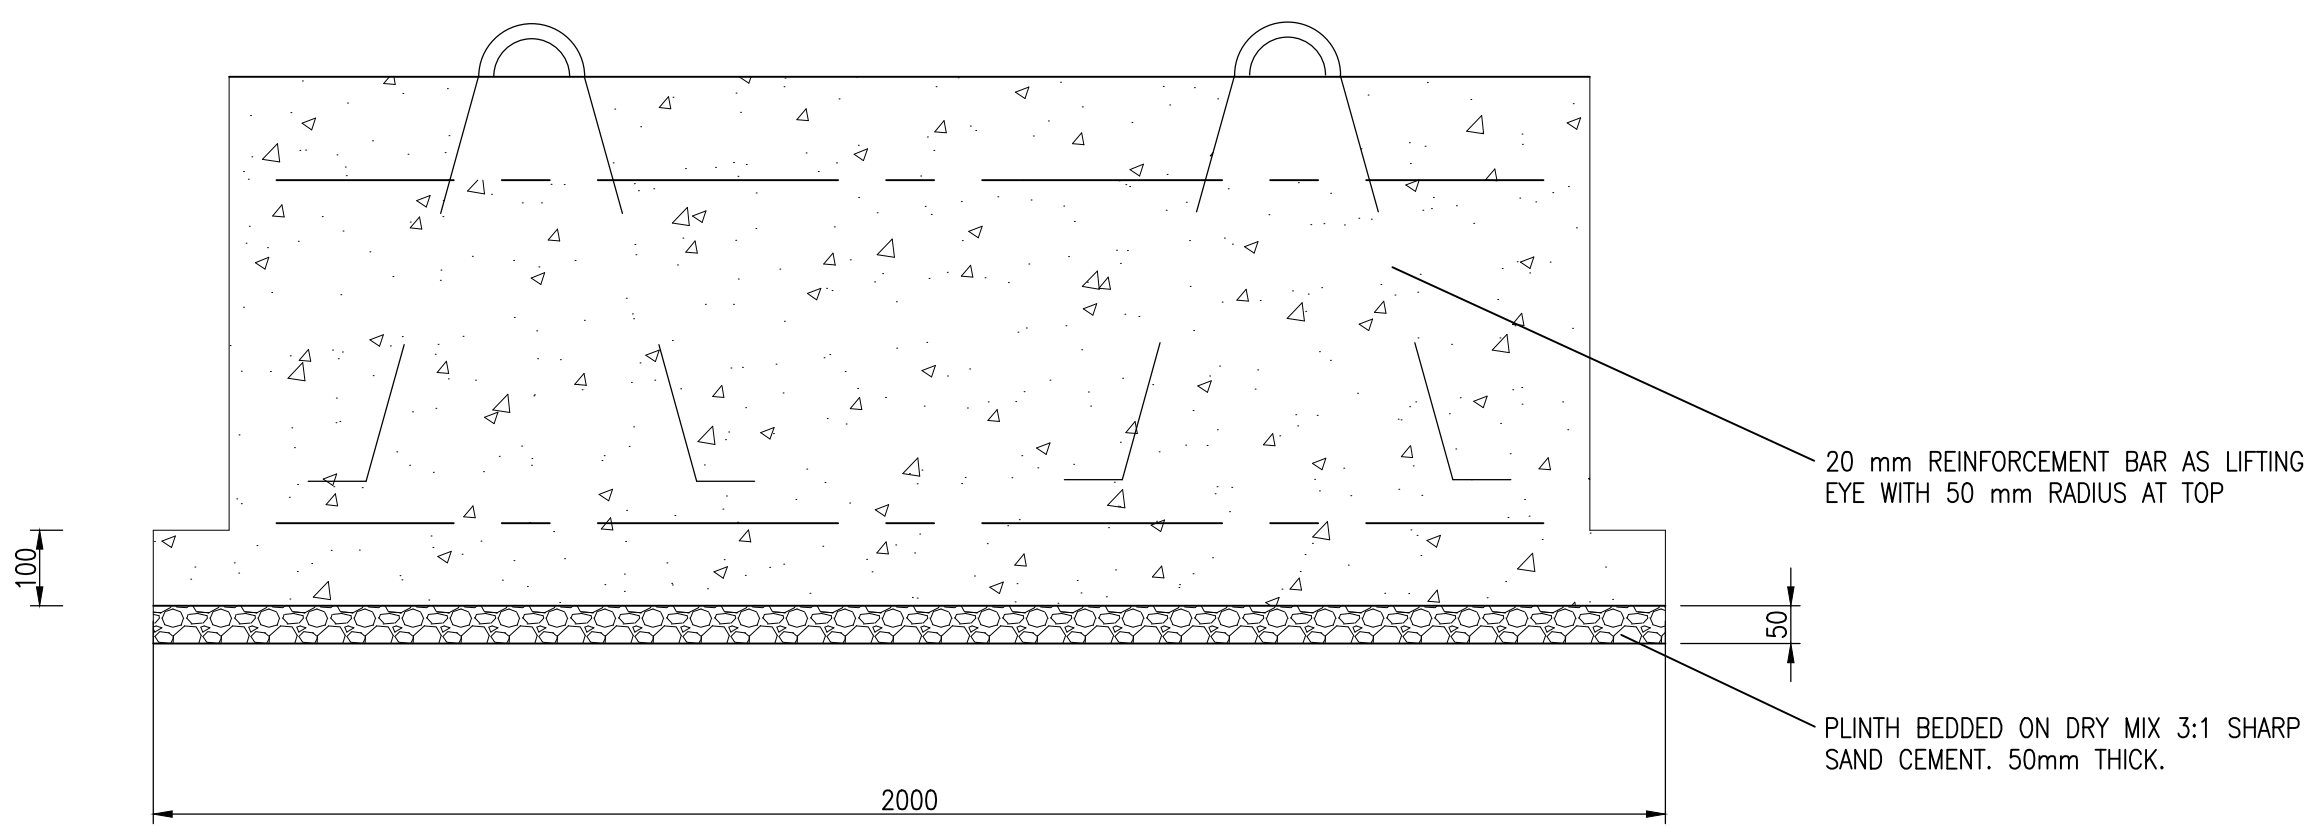

SECTION X : X

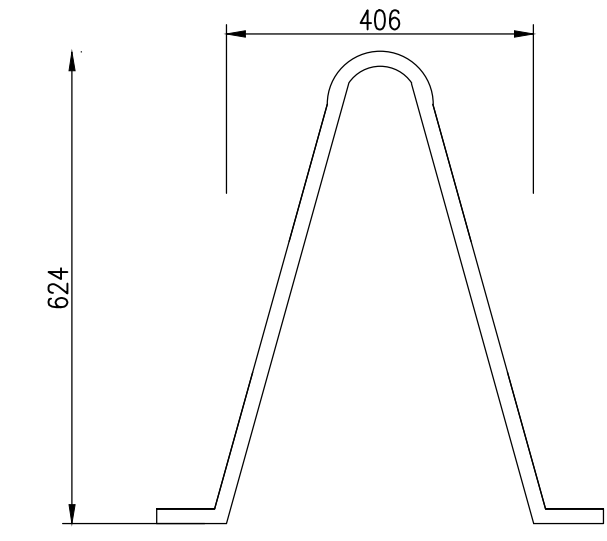

REINFORCEMENT BAR DETAIL


SITE NOTES

1. CONTRACTOR TO OBTAIN UNDERGROUND CABLE & SERVICE RECORDS PRIOR TO COMMENCEMENT OF ANY WORKS.
2. THE CONTRACTOR MUST ASSUME THAT ANY EXISTING CABLES LOCATED WITHIN THE WORKS ARE LIVE AND LIAISE WITH THE ELECTRICITY NORTHWEST ENGINEER FOR ADVICE.
3. SITE SPECIFIC RISK ASSESSMENT TO BE UNDERTAKEN PRIOR TO COMMENCEMENT OF ANY WORKS.
4. FOUNDATION DESIGN HAS BEEN BASED ON A SUITABLE BEARING PRESSURE FOR MOST GROUND CONDITIONS INCLUDING CLAYS. FORMATION LEVEL FOR FOUNDATIONS TO BE TAKEN DOWN TO GROUND THAT IS SUFFICIENTLY FIRM TO PROVIDE PHYSICAL SUPPORT TO THE STRUCTURE.
5. FOUNDATION FORMATION LEVELS TO BE INSPECTED AND APPROVED PRIOR TO FOUNDATION CONSTRUCTION.

GENERAL NOTES

1. DO NOT SCALE.
2. ALL DIMENSIONS ARE IN MILLIMETRES UNLESS NOTED OTHERWISE.
3. THIS DRAWING IS TO BE READ IN CONJUNCTION WITH ELECTRICITY NORTHWEST CODE OF PRACTICE ES352
4. ALL WORK TO CARRIED OUT IN ACCORDANCE WITH CURRENT BUILDING REGULATIONS AND RELEVANT BRITISH STANDARDS AND CODES OF PRACTICE.
5. CONCRETE TO BE STRENGTH CLASS C32/40 TO BS8500

NOT TO SCALE

				FREDERICK ROAD, SALFORD M6 6QH TEL 0161 6041370				CIVIL DISTRIBUTION SUBSTATION PLINTH FOR TRANSPORTABLE UNIT SUBSTATION			
DRAWN	JEWB	SCALE	NTS	SITE NAME							
APPROVED	-	DATE	JULY 16	P.F.R. NO.	-	DWG STATUS	APPROVAL				
OLD DWG NO	-	SHEET SIZE	A2	DWG NO	900350-021	REV	0				